




1 ROOFTOP UNIT DETAIL
M201 NONE

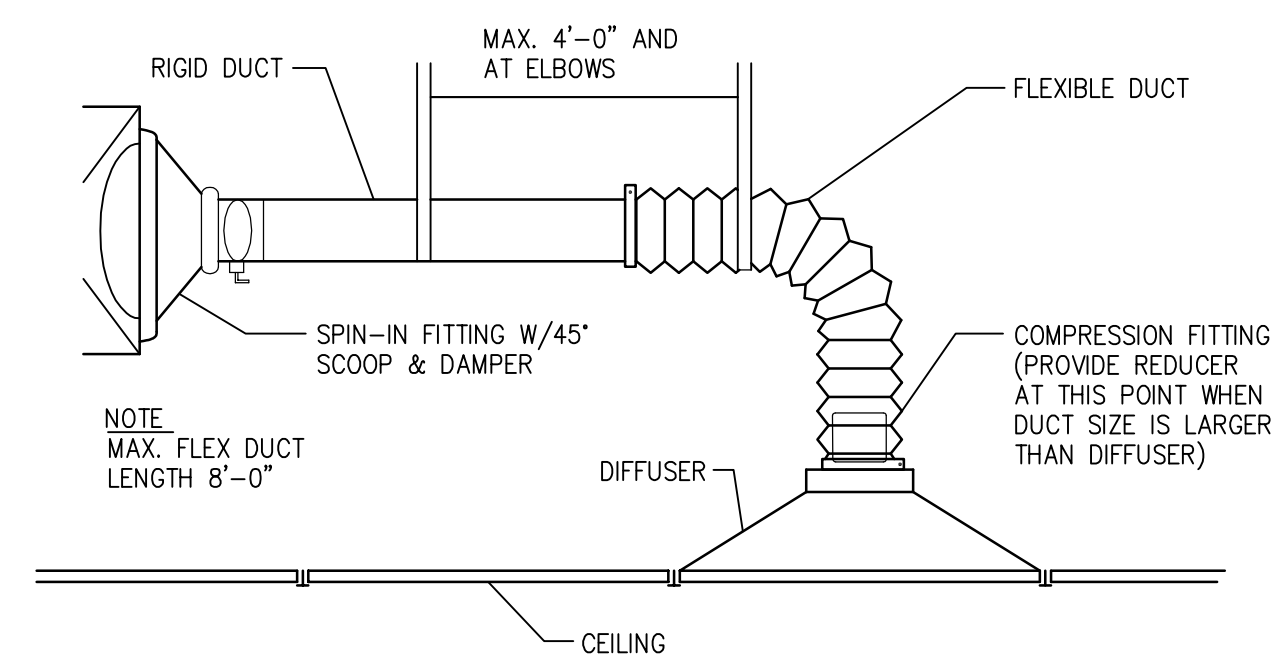


2 DUCT/DIFFUSER DETAIL
M201 NONE

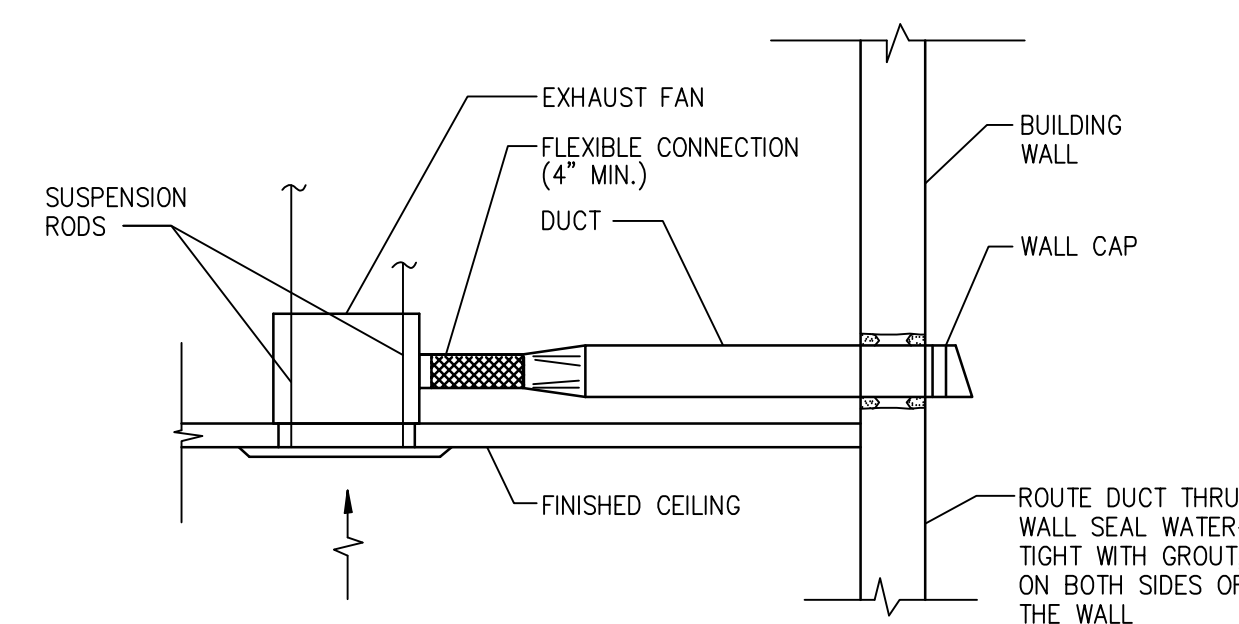


3 EXHAUST FAN THRU WALL DETAIL
M201 NONE

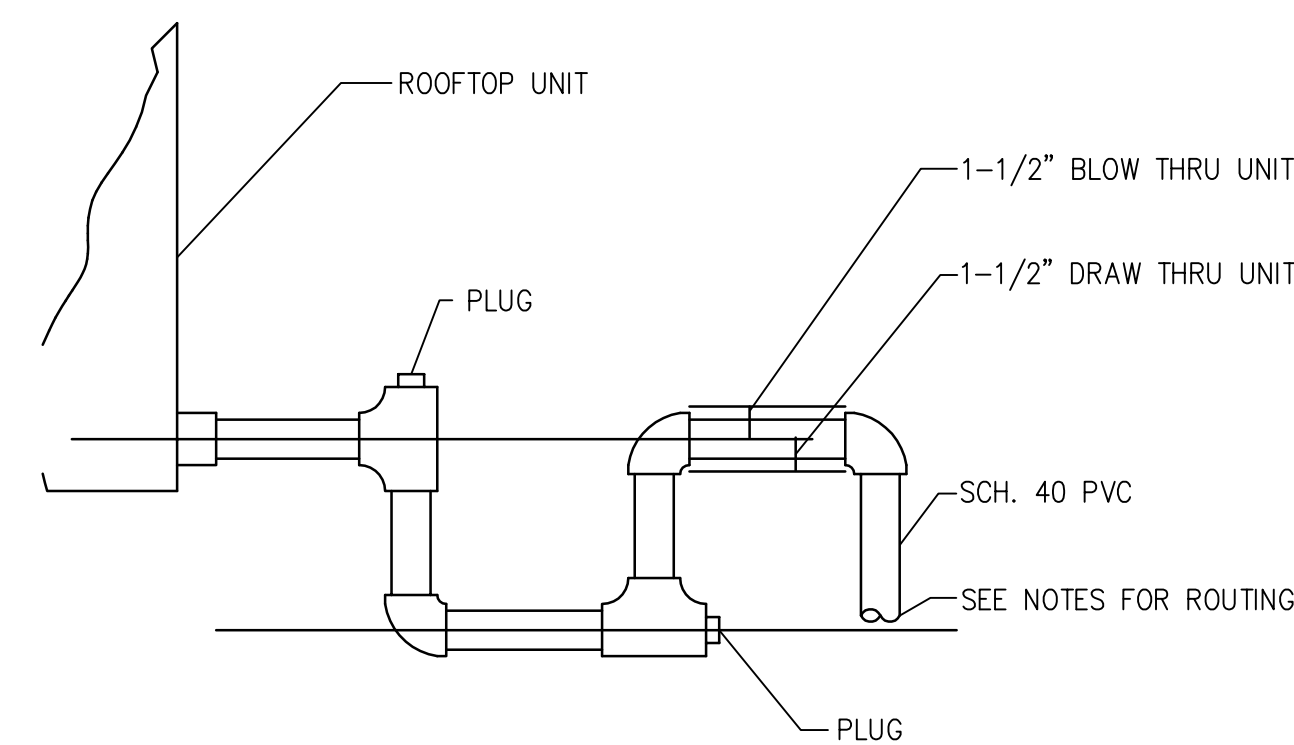


4 CONDENSATE TRAP DETAIL
M201 NONE

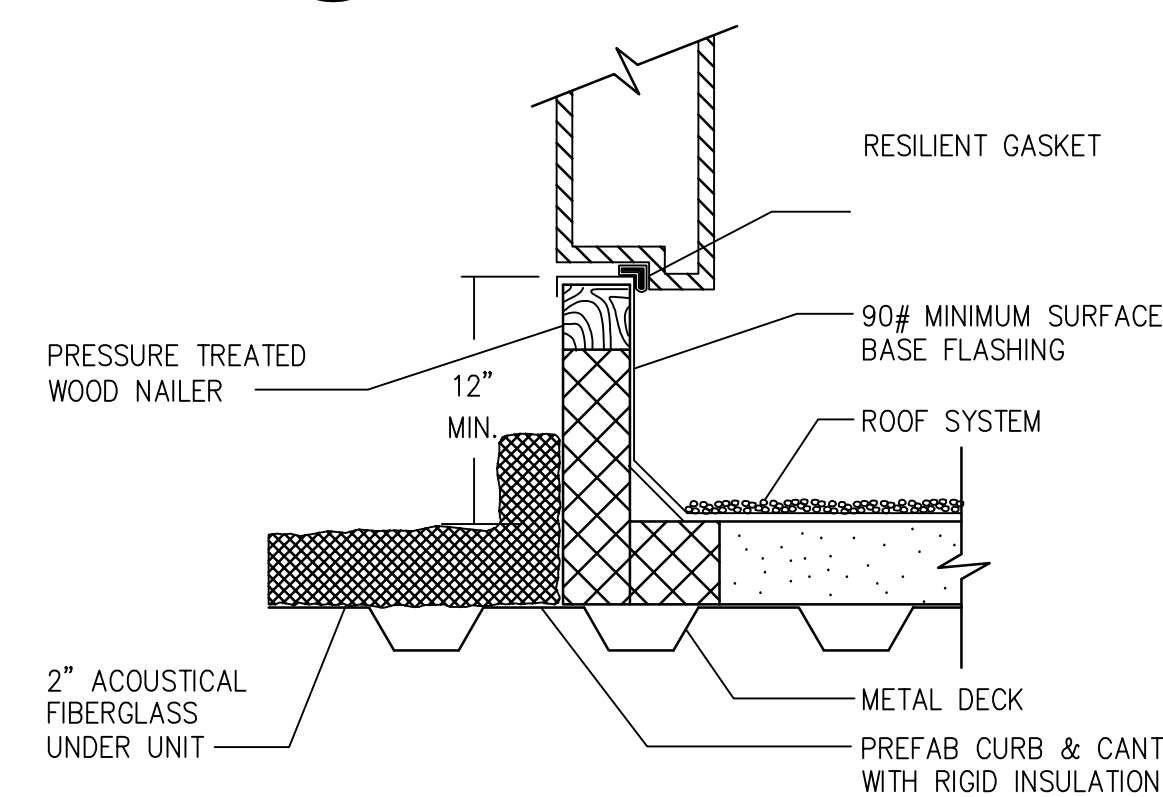

5 ROOFTOP UNIT CURB DETAIL
M201 NONE

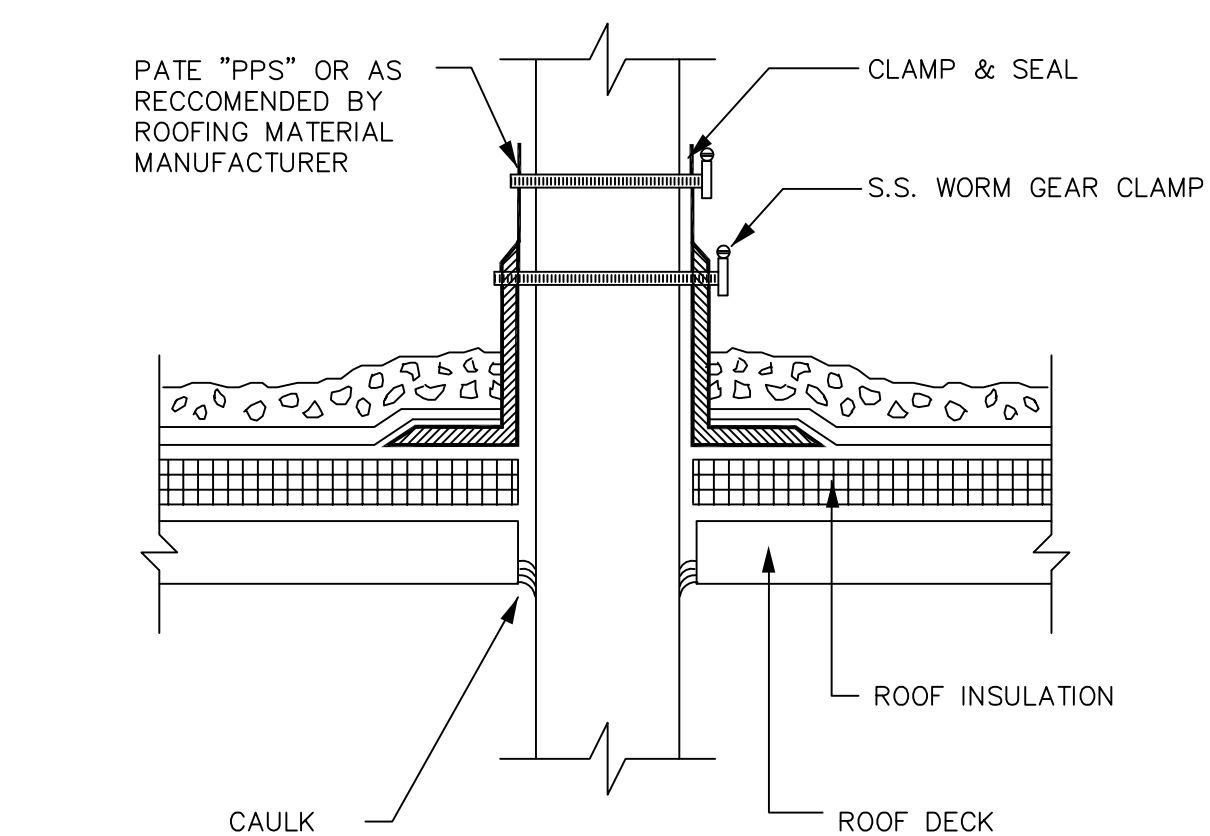

6 PIPE PENETRATION THRU ROOF DETAIL
M201 NONE

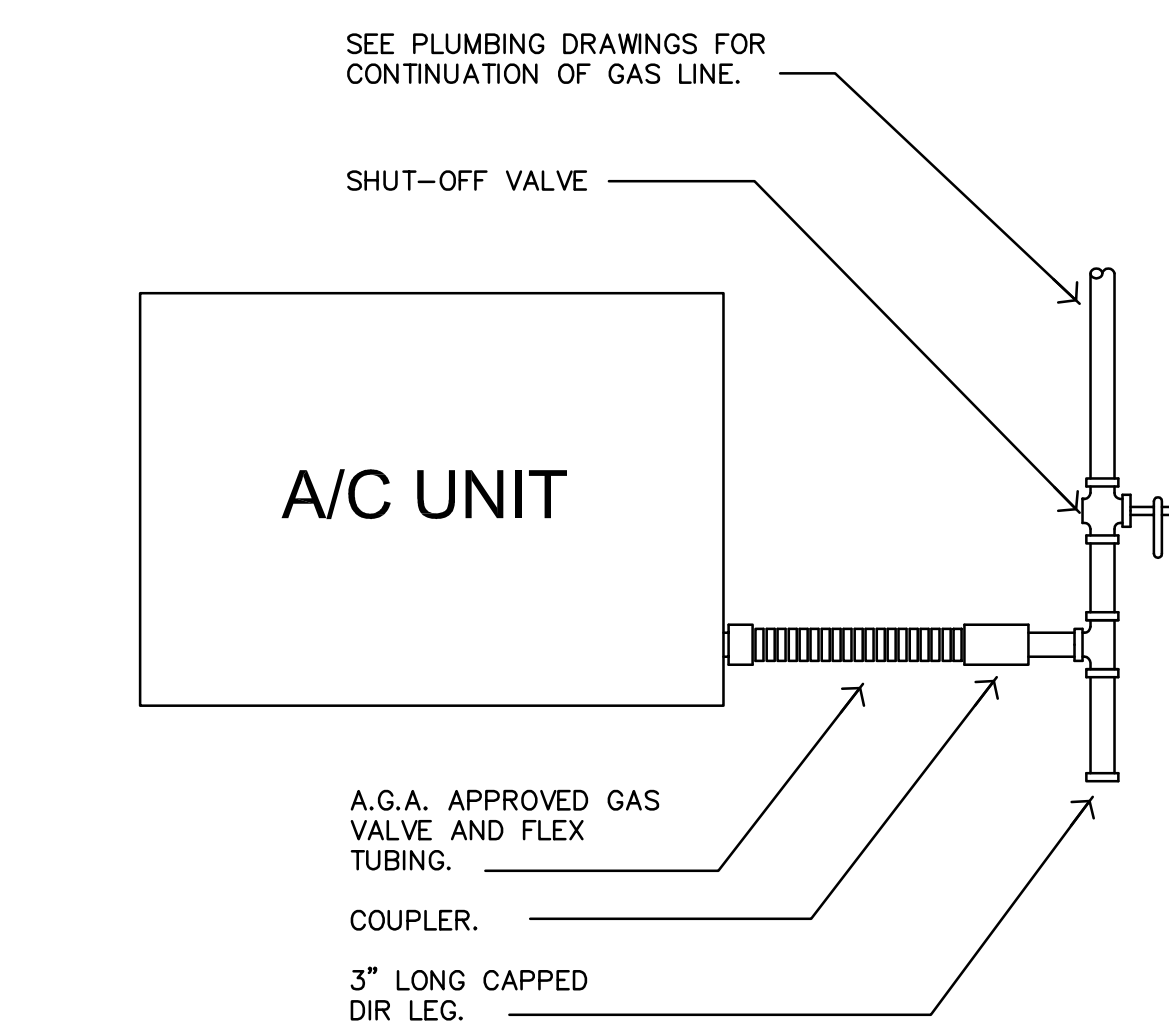

7 NATURAL GAS CONNECTION DETAIL
M102 NONE

Bob Beach, PE LEED AP
South Carolina PE #14858
bbeach@bestengineeringsolutions.com
(678) 665-3280



**NEW RETAIL BUILDING
KITTTIES CROSSING**
21 BLUFFTON ROAD
BLUFFTON, SC 29910

03/14/17 BID ISSUANCE
REVISIONS: ADDENDA #1

ISSUED: 03/10/2017

**HVAC -
Details**

M201